

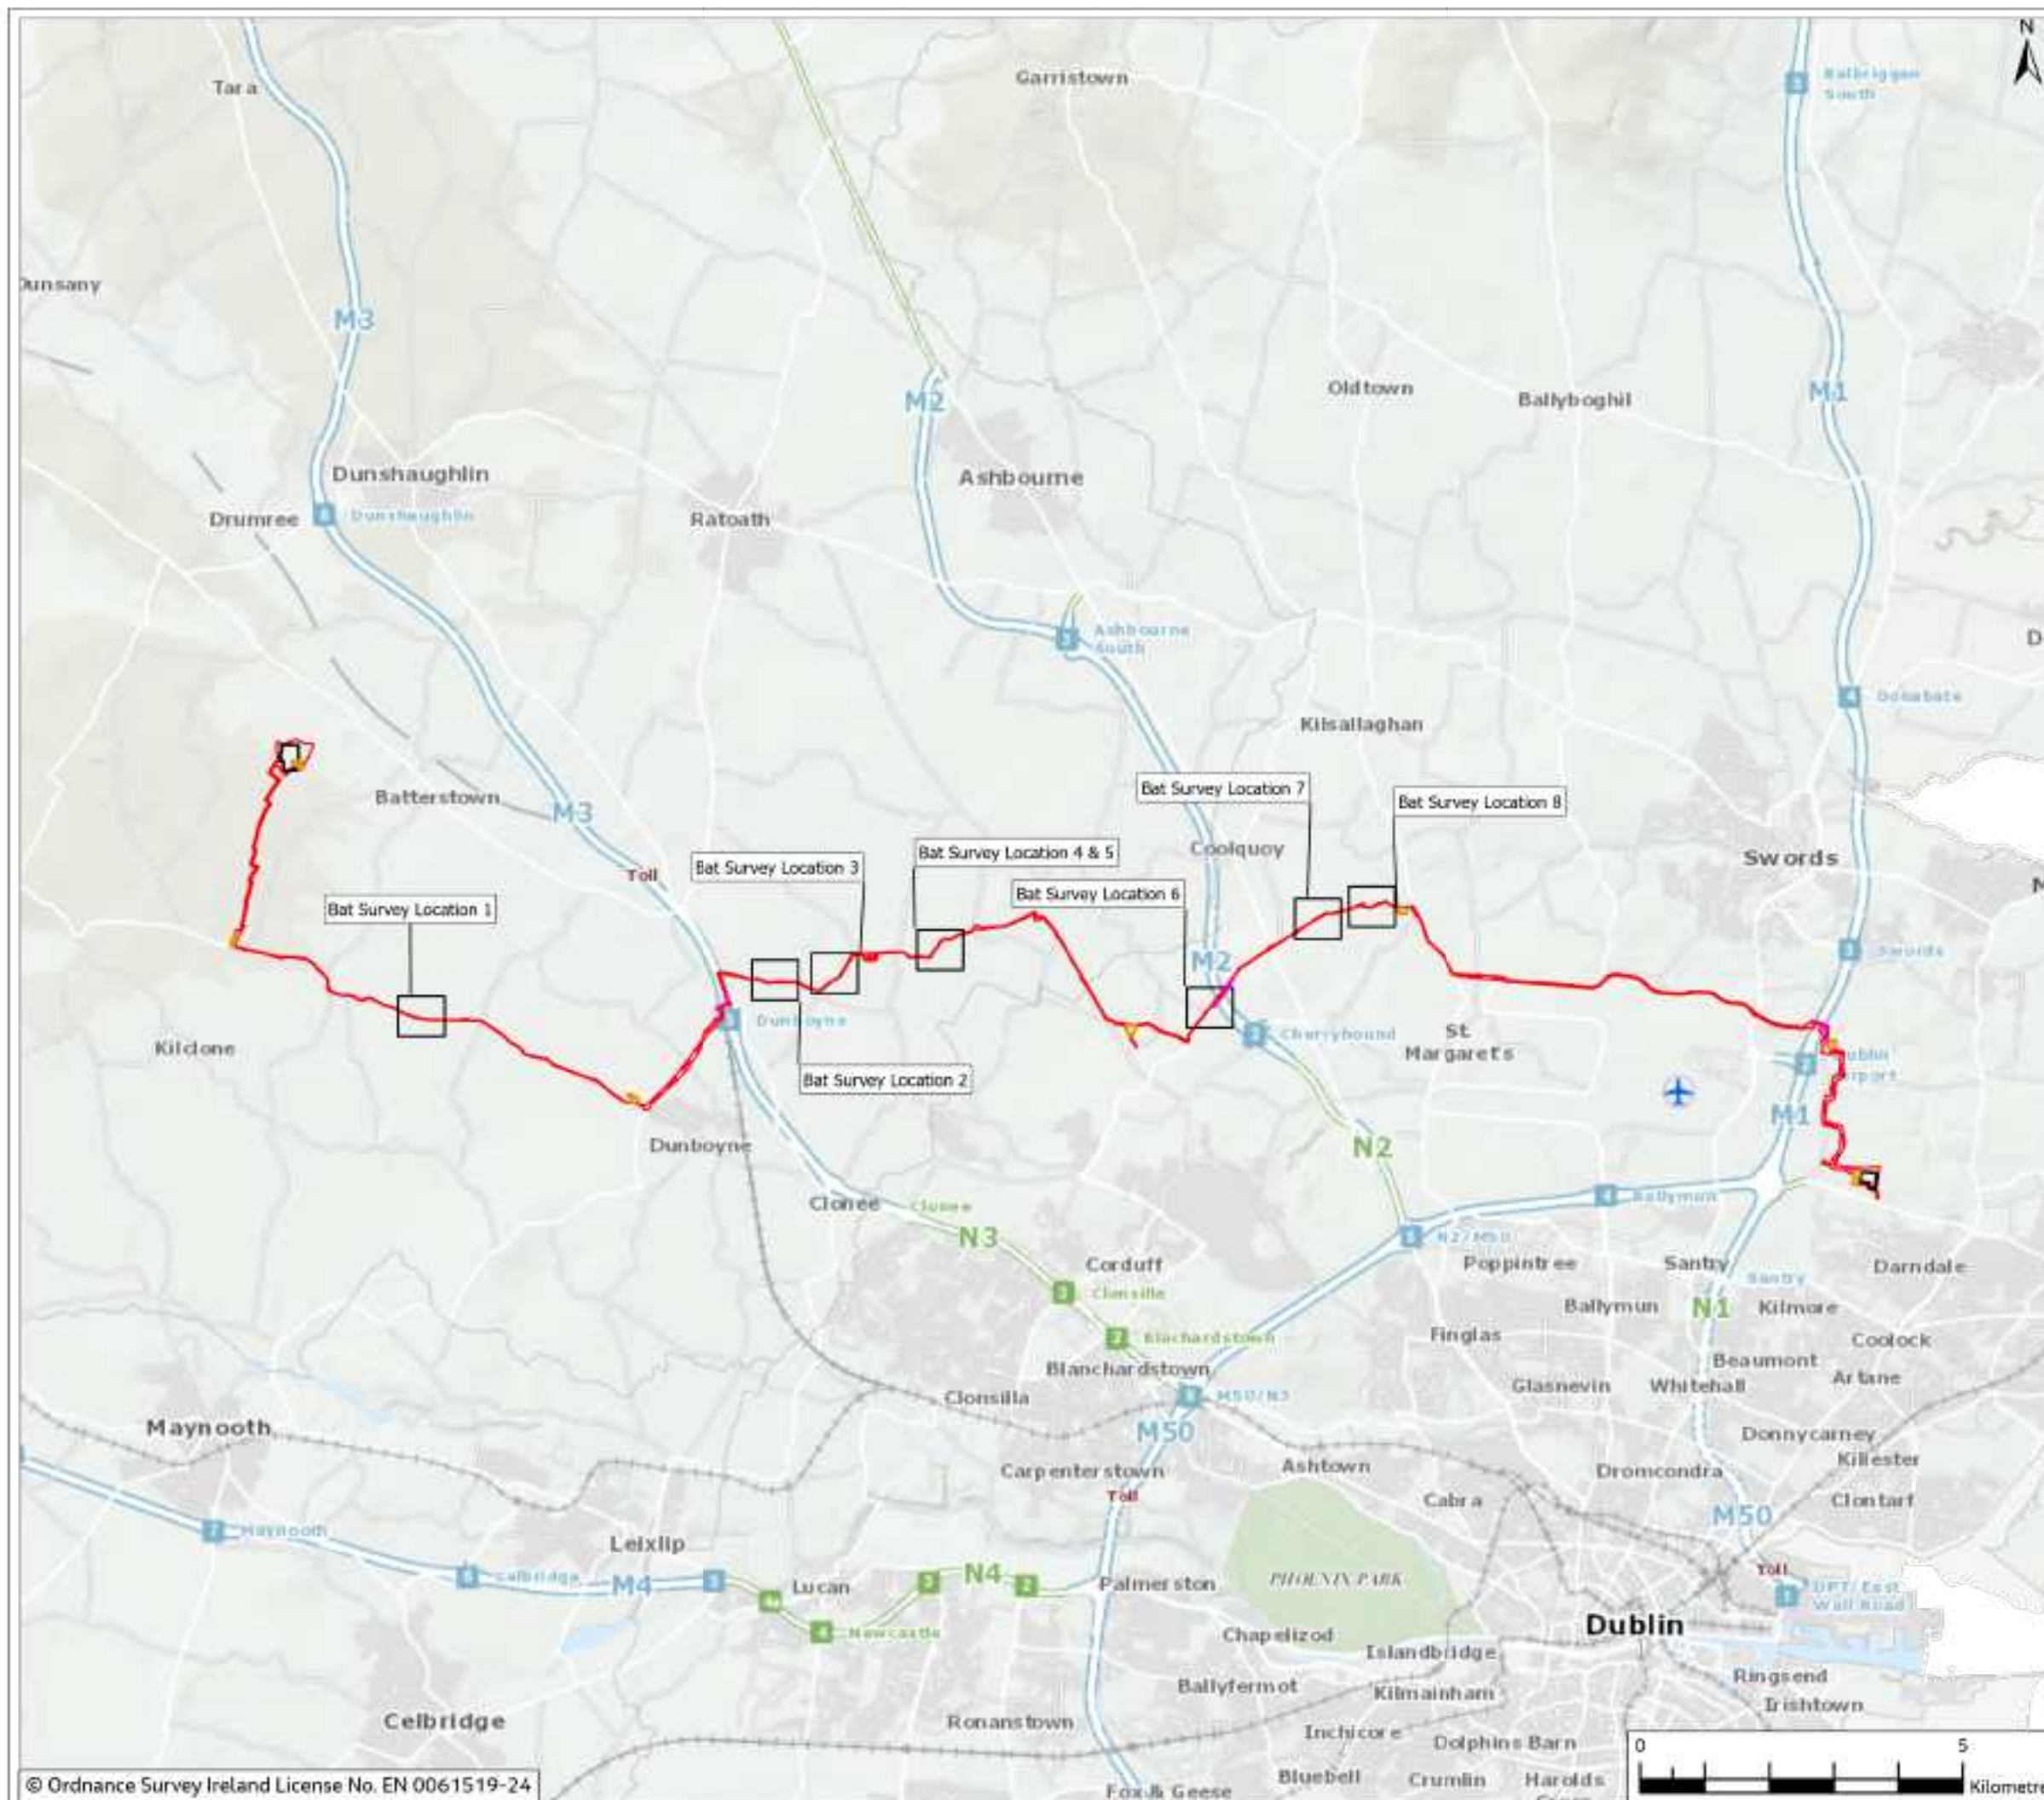


Figure 10.6

Legend

- Planning Application Boundary (PAB)
- Proposed Cable Route
- HDD Compound
- Temporary Construction Compound
- Substation Footprint

0	Mar 2024	Final	HS	FS	RS	CS
Rev	Date	Purpose of revision	Drawn	Checked	Revised	Approved

Jacobs

EirGrid

East Meath - North Dublin Grid Upgrade

Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 1 of 8)

Scale @ A3: 1:100,000 DO NOT SCALE


OS Sheet No. B321084AJ

Drawing No. 321084AJ-JAC-ZZ-XX-DR-G-0114

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.

© Ordnance Survey Ireland License No. EN 0061519-24

Figure 10.6

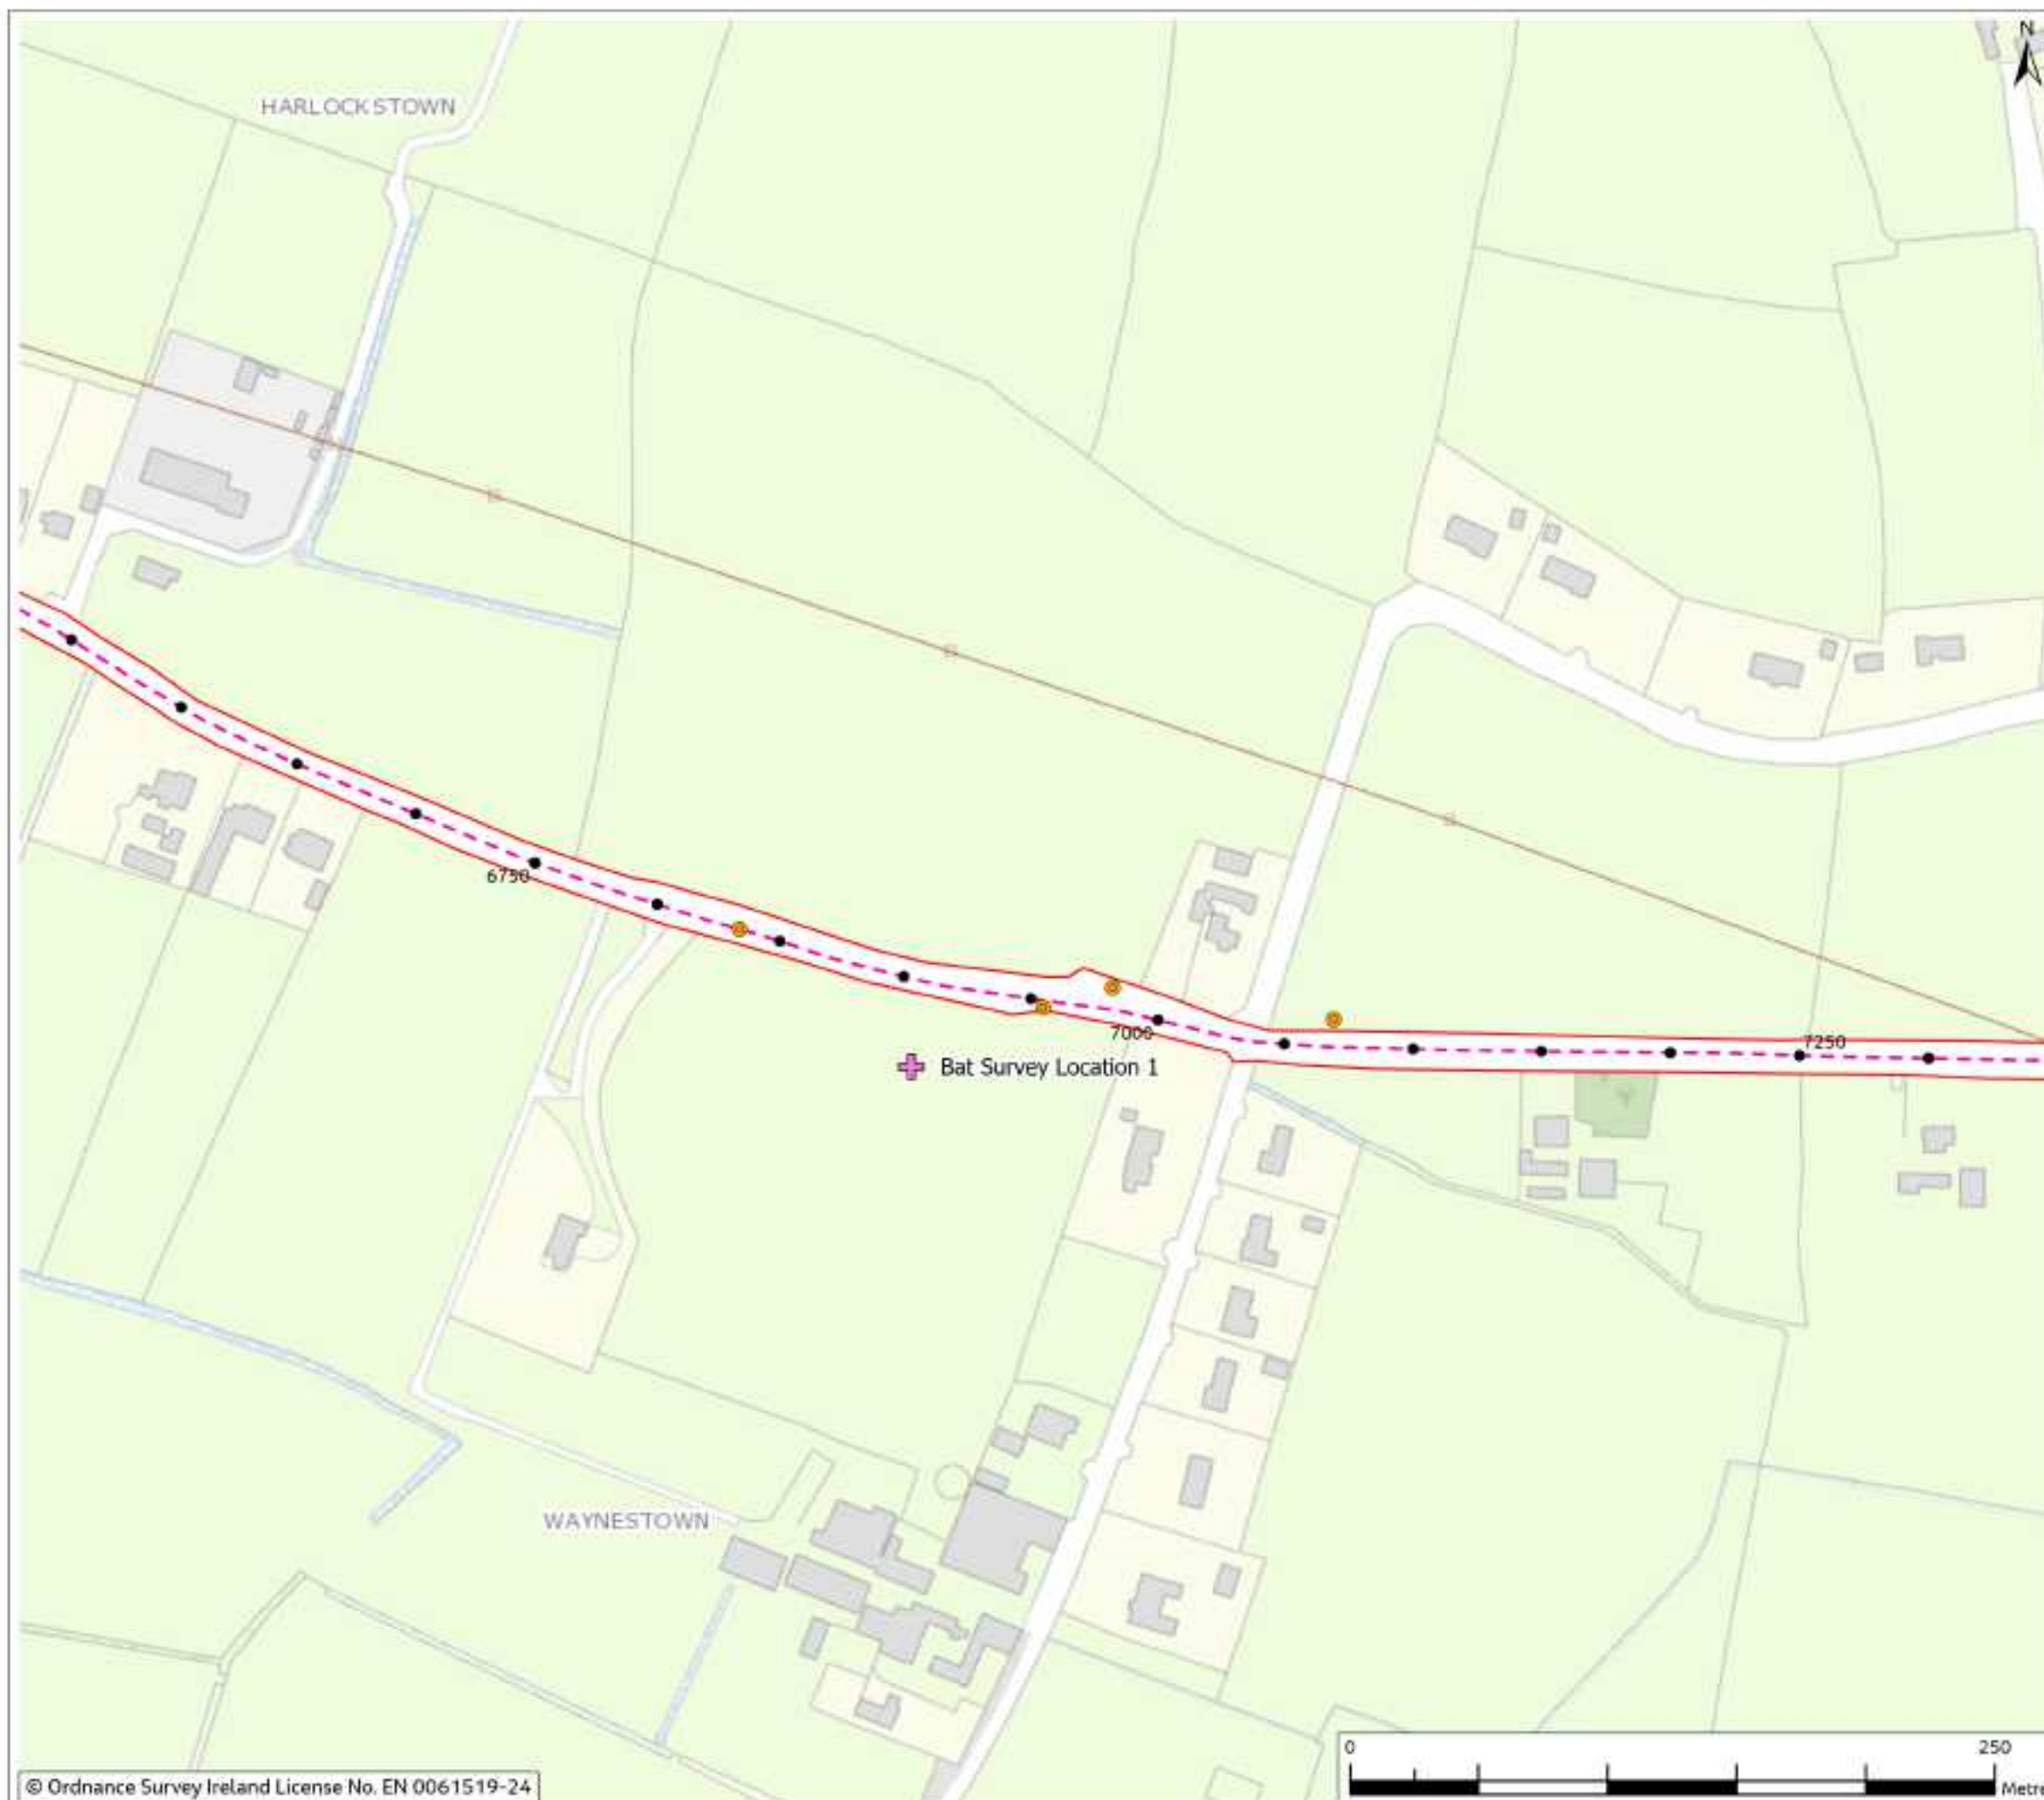

Legend

- Chainage
 - Planning Application Boundary (PAB)
 - - - Proposed Cable Route
 - ✚ Bat Survey Location
- Ground assessment of tree roosting potential**
- High Potential
 - Moderate Potential

Bat Survey Location Group 1

Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lai	M.nat	P.aur
Yes	Yes	Yes	Yes	No



0	1	2	3	4	5
Mar 2024	Final	Rev	PS	RS	CS
Rev	Date	Purpose of revision	Drawn	Checked	Rev'd

Jacobs

Client:



Project:

East Meath - North Dublin Grid Upgrade

Drawing Title:

Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 2 of 8)

Drawing Status:

FINAL

Scale @ A3:

1:2,500

DO NOT SCALE

OS Sheet No.:

832108AAJ

Jacobs No.:

321084AJ-JAC-ZZ-XX-DR-G-0115

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.

Figure 10.6

Legend

- Chainage
 - Planning Application Boundary (PAB)
 - - - Proposed Cable Route
 - ✚ Bat Survey Location
- Ground assessment of tree roosting potential**
- High Potential
 - Moderate Potential

Bat Survey Location Group 2

Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lai	M.nat	P.aur
Yes	Yes	Yes	Yes	Yes



Rev	Date	Purpose of revision	Drawn	Checked	Rev'd	App'd
0	Mar 2024	Final				

Jacobs

Client:



Project:

East Meath - North Dublin Grid Upgrade

Drawing Title:

Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 3 of 8)

Drawing Status:

FINAL

Scale @ A3: 1:2,500 DO NOT SCALE

OS Sheet No.

Jacobs No. 8321084AJ

Drawing No.

321084AJ-JAC-ZZ-XX-DR-G-0116

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.





Figure 10.6

Legend

- Chainage
 - Planning Application Boundary (PAB)
 - - - Proposed Cable Route
 - ✚ Bat Survey Location
- Ground assessment of tree roosting potential
- High Potential
 - Moderate Potential

Bat Survey Location Group 3

Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lai	M.nat	P.aur
Yes	Yes	Yes	No	Yes



Rev	Date	Purpose of revision	Drawn	Checked	Revised	App'd
0	Mar 2024	Final				

Jacobs

Client:



Project:

East Meath - North Dublin Grid Upgrade

Drawing Title:

Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 4 of 8)

Drawing Status:

FINAL

Scale @ A3:

1:2,500

DO NOT SCALE

OS Sheet No.:

8321084AJ

Jacobs No.:

321084AJ-JAC-ZZ-XX-DR-G-0117

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.



Figure 10.6

Legend

- Chainage
 - Planning Application Boundary (PAB)
 - - - Proposed Cable Route
 - ✚ Bat Survey Location
- Ground assessment of tree roosting potential**
- High Potential
 - Moderate Potential

Bat Survey Location Group 4

Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lei	M.nat	P.aur
Yes	Yes	Yes	No	No

Bat Survey Location Group 5

Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lei	M.nat	P.aur
Yes	Yes	Yes	No	No



Rev	Date	Purpose of revision	Drawn	Checked	Revised	App'd
0	Mar 2024	Final				

Jacobs



Project
East Meath - North Dublin Grid Upgrade

Drawing Title
Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 5 of 8)

Drawing Status		FINAL	
Scale @ A3	1:2,500	DO NOT SCALE	
CSI Sheet No.			
Jacobs No.	8321084AJ		
Drawing No.	321084AJ-JAC-ZZ-XX-DR-G-0118		

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.

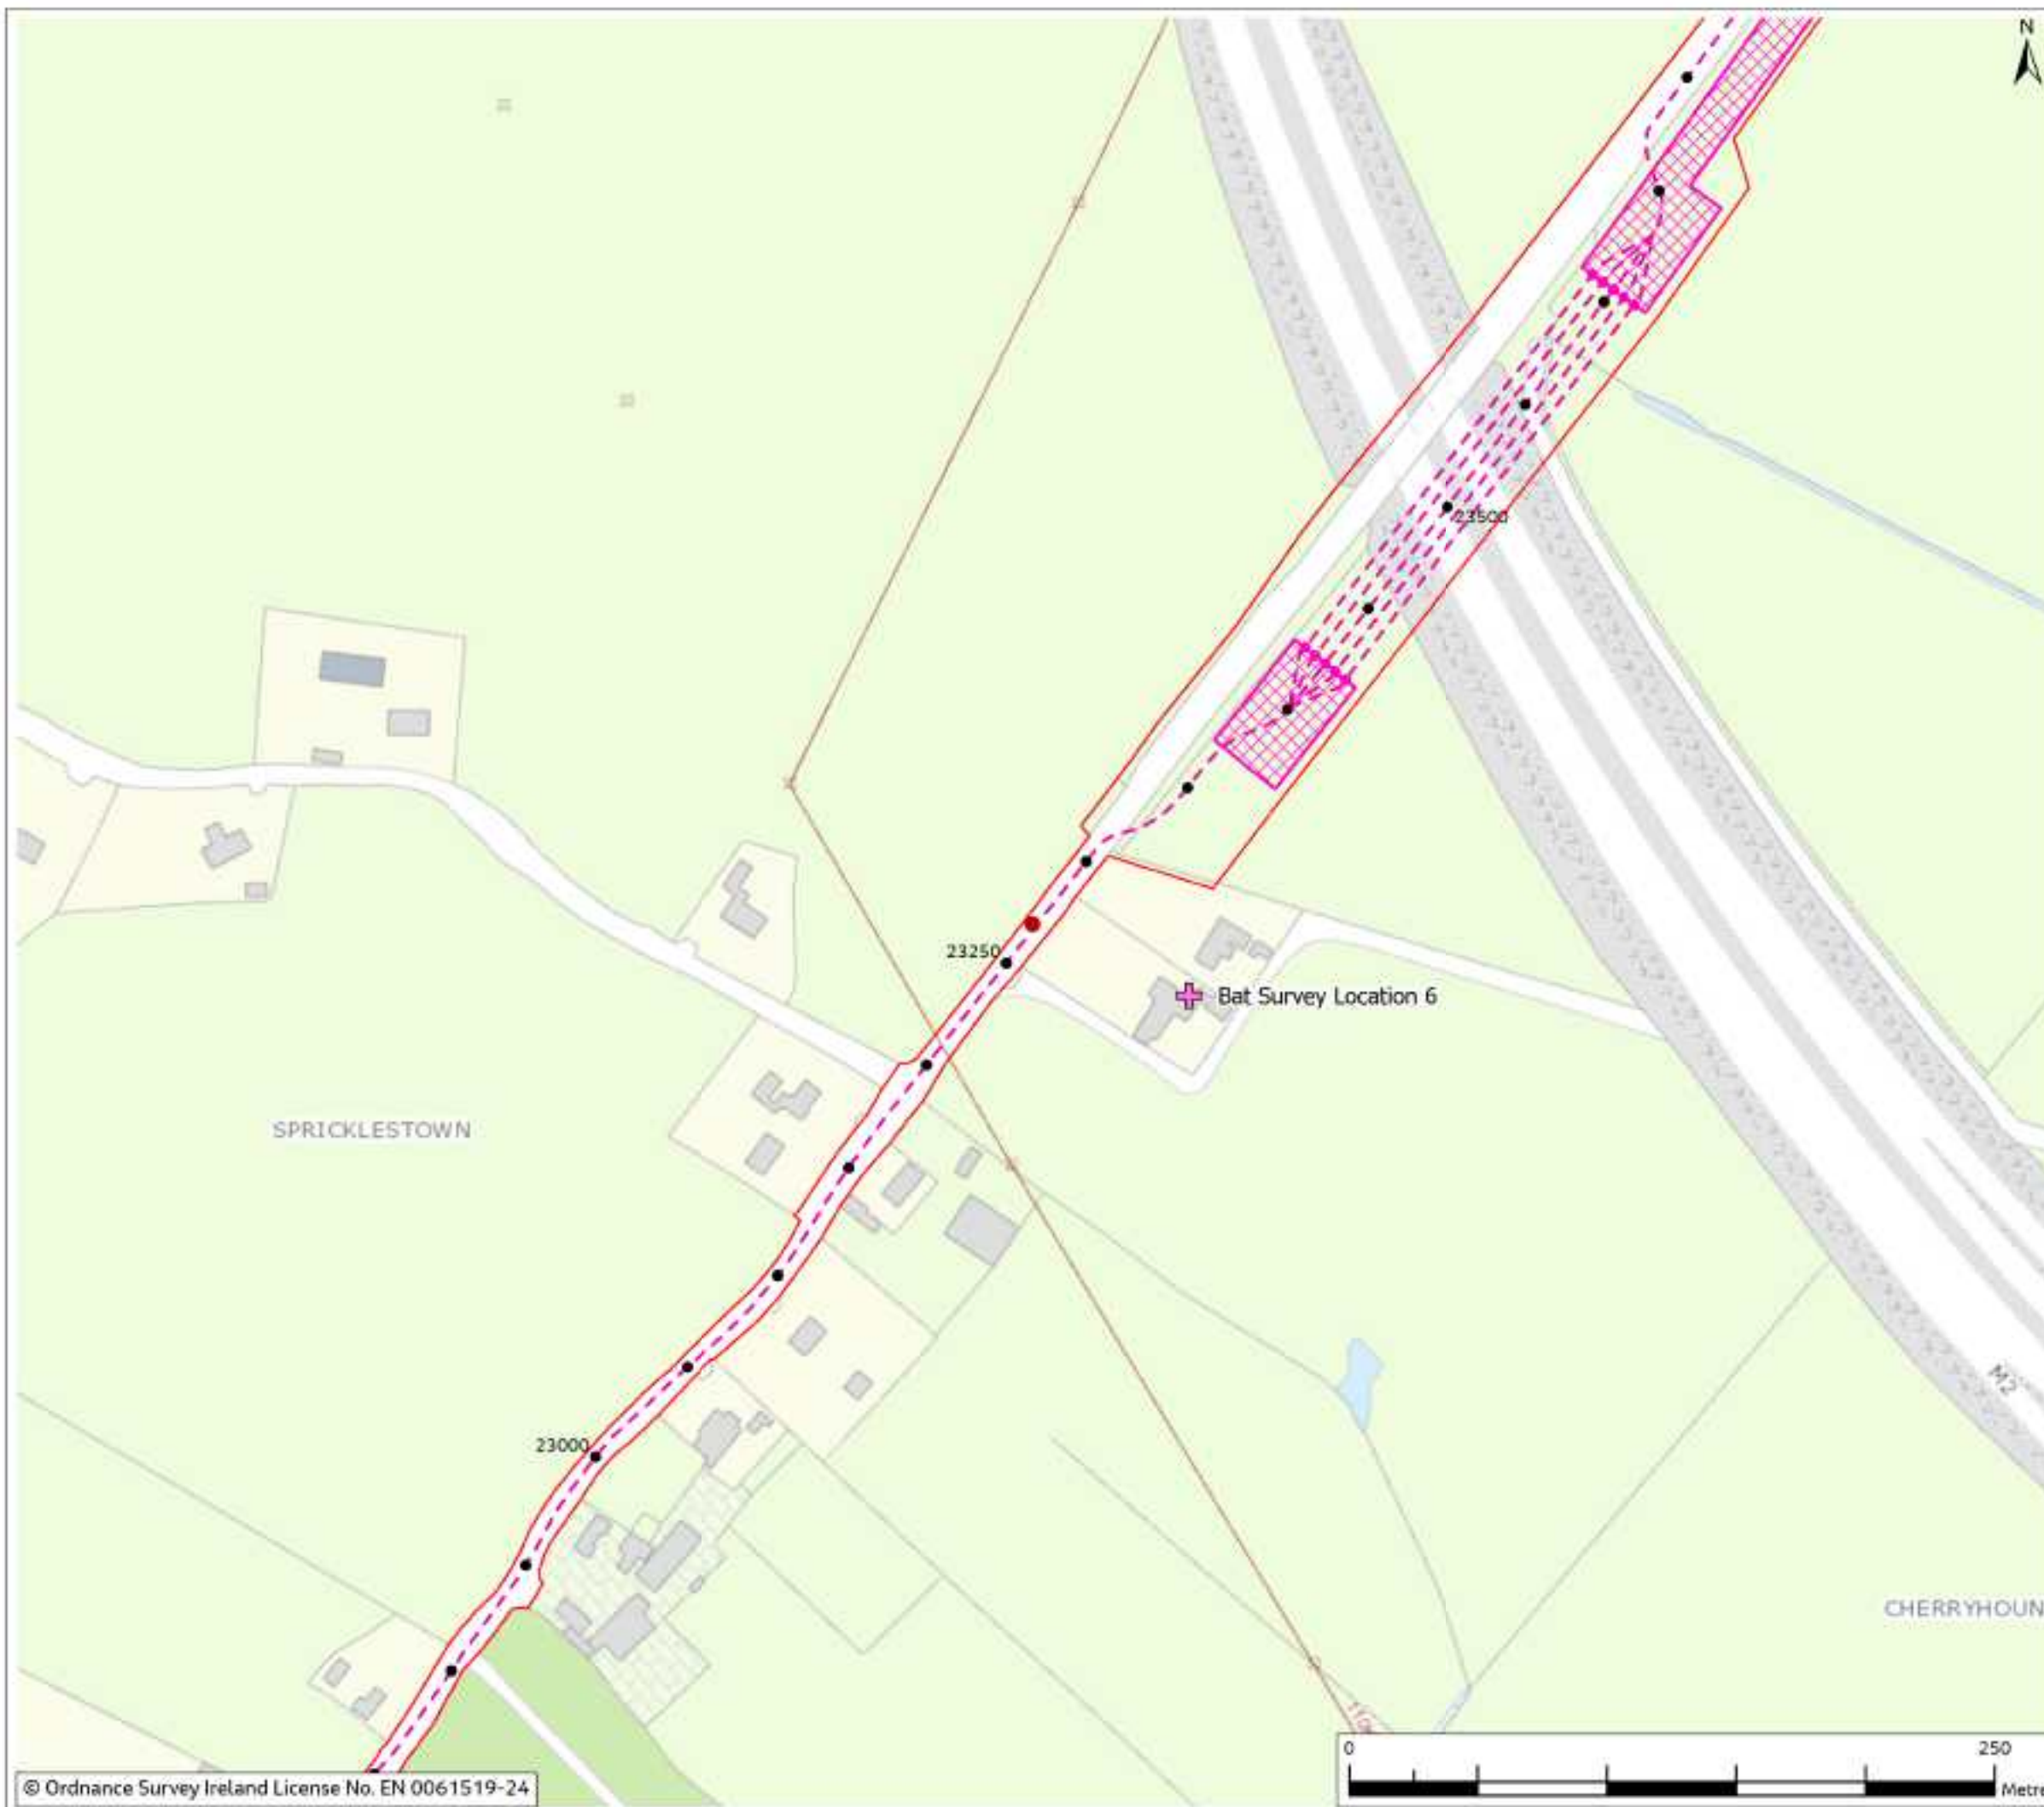


Figure 10.6

Legend

- Chainage
 - Planning Application Boundary (PAB)
 - - - Proposed Cable Route
 - ▨ HDD Compound
 - ✚ Bat Survey Location
- Ground assessment of tree roosting potential
- High Potential
 - Moderate Potential

Bat Survey Location Group 6

Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lei	M.nat	P.aur
Yes	Yes	Yes	No	No



Rev	Date	Purpose of revision	Drawn	Checked	Revised	App'd
0	Mar 2024	Final	HS	PS	RS	CS

Jacobs

Client



Project

East Meath - North Dublin Grid Upgrade

Drawing Title

Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 6 of 8)

Drawing Status

FINAL

Scale @ A3 1:2,500 DO NOT SCALE

OS Sheet No.

Jacobs No. 8321084AJ

Drawing No.

321084AJ-JAC-ZZ-XX-DR-G-0119

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.

Figure 10.6

Legend

- Chainage
 - Planning Application Boundary (PAB)
 - - - Proposed Cable Route
 - ✚ Bat Survey Location
- Ground assessment of tree roosting potential**
- High Potential
 - Moderate Potential

Bat Survey Location Group 7

Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lai	M.nat	P.aur
Yes	Yes	Yes	No	No



0	Mar 2024	Final	Rev	PS	RS	CS
Rev	Date	Purpose of revision	Drawn	Checked	Rev'd	App'd

Jacobs




Client: East Meath - North Dublin Grid Upgrade

Drawing Title: Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 7 of 8)

Drawing Status	FINAL
Scale @ A3	1:2,500 DO NOT SCALE
OS Sheet No.	
Jacobs No.	8321084AJ
Drawing No.	321084AJ-JAC-ZZ-XX-DR-G-0120

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.

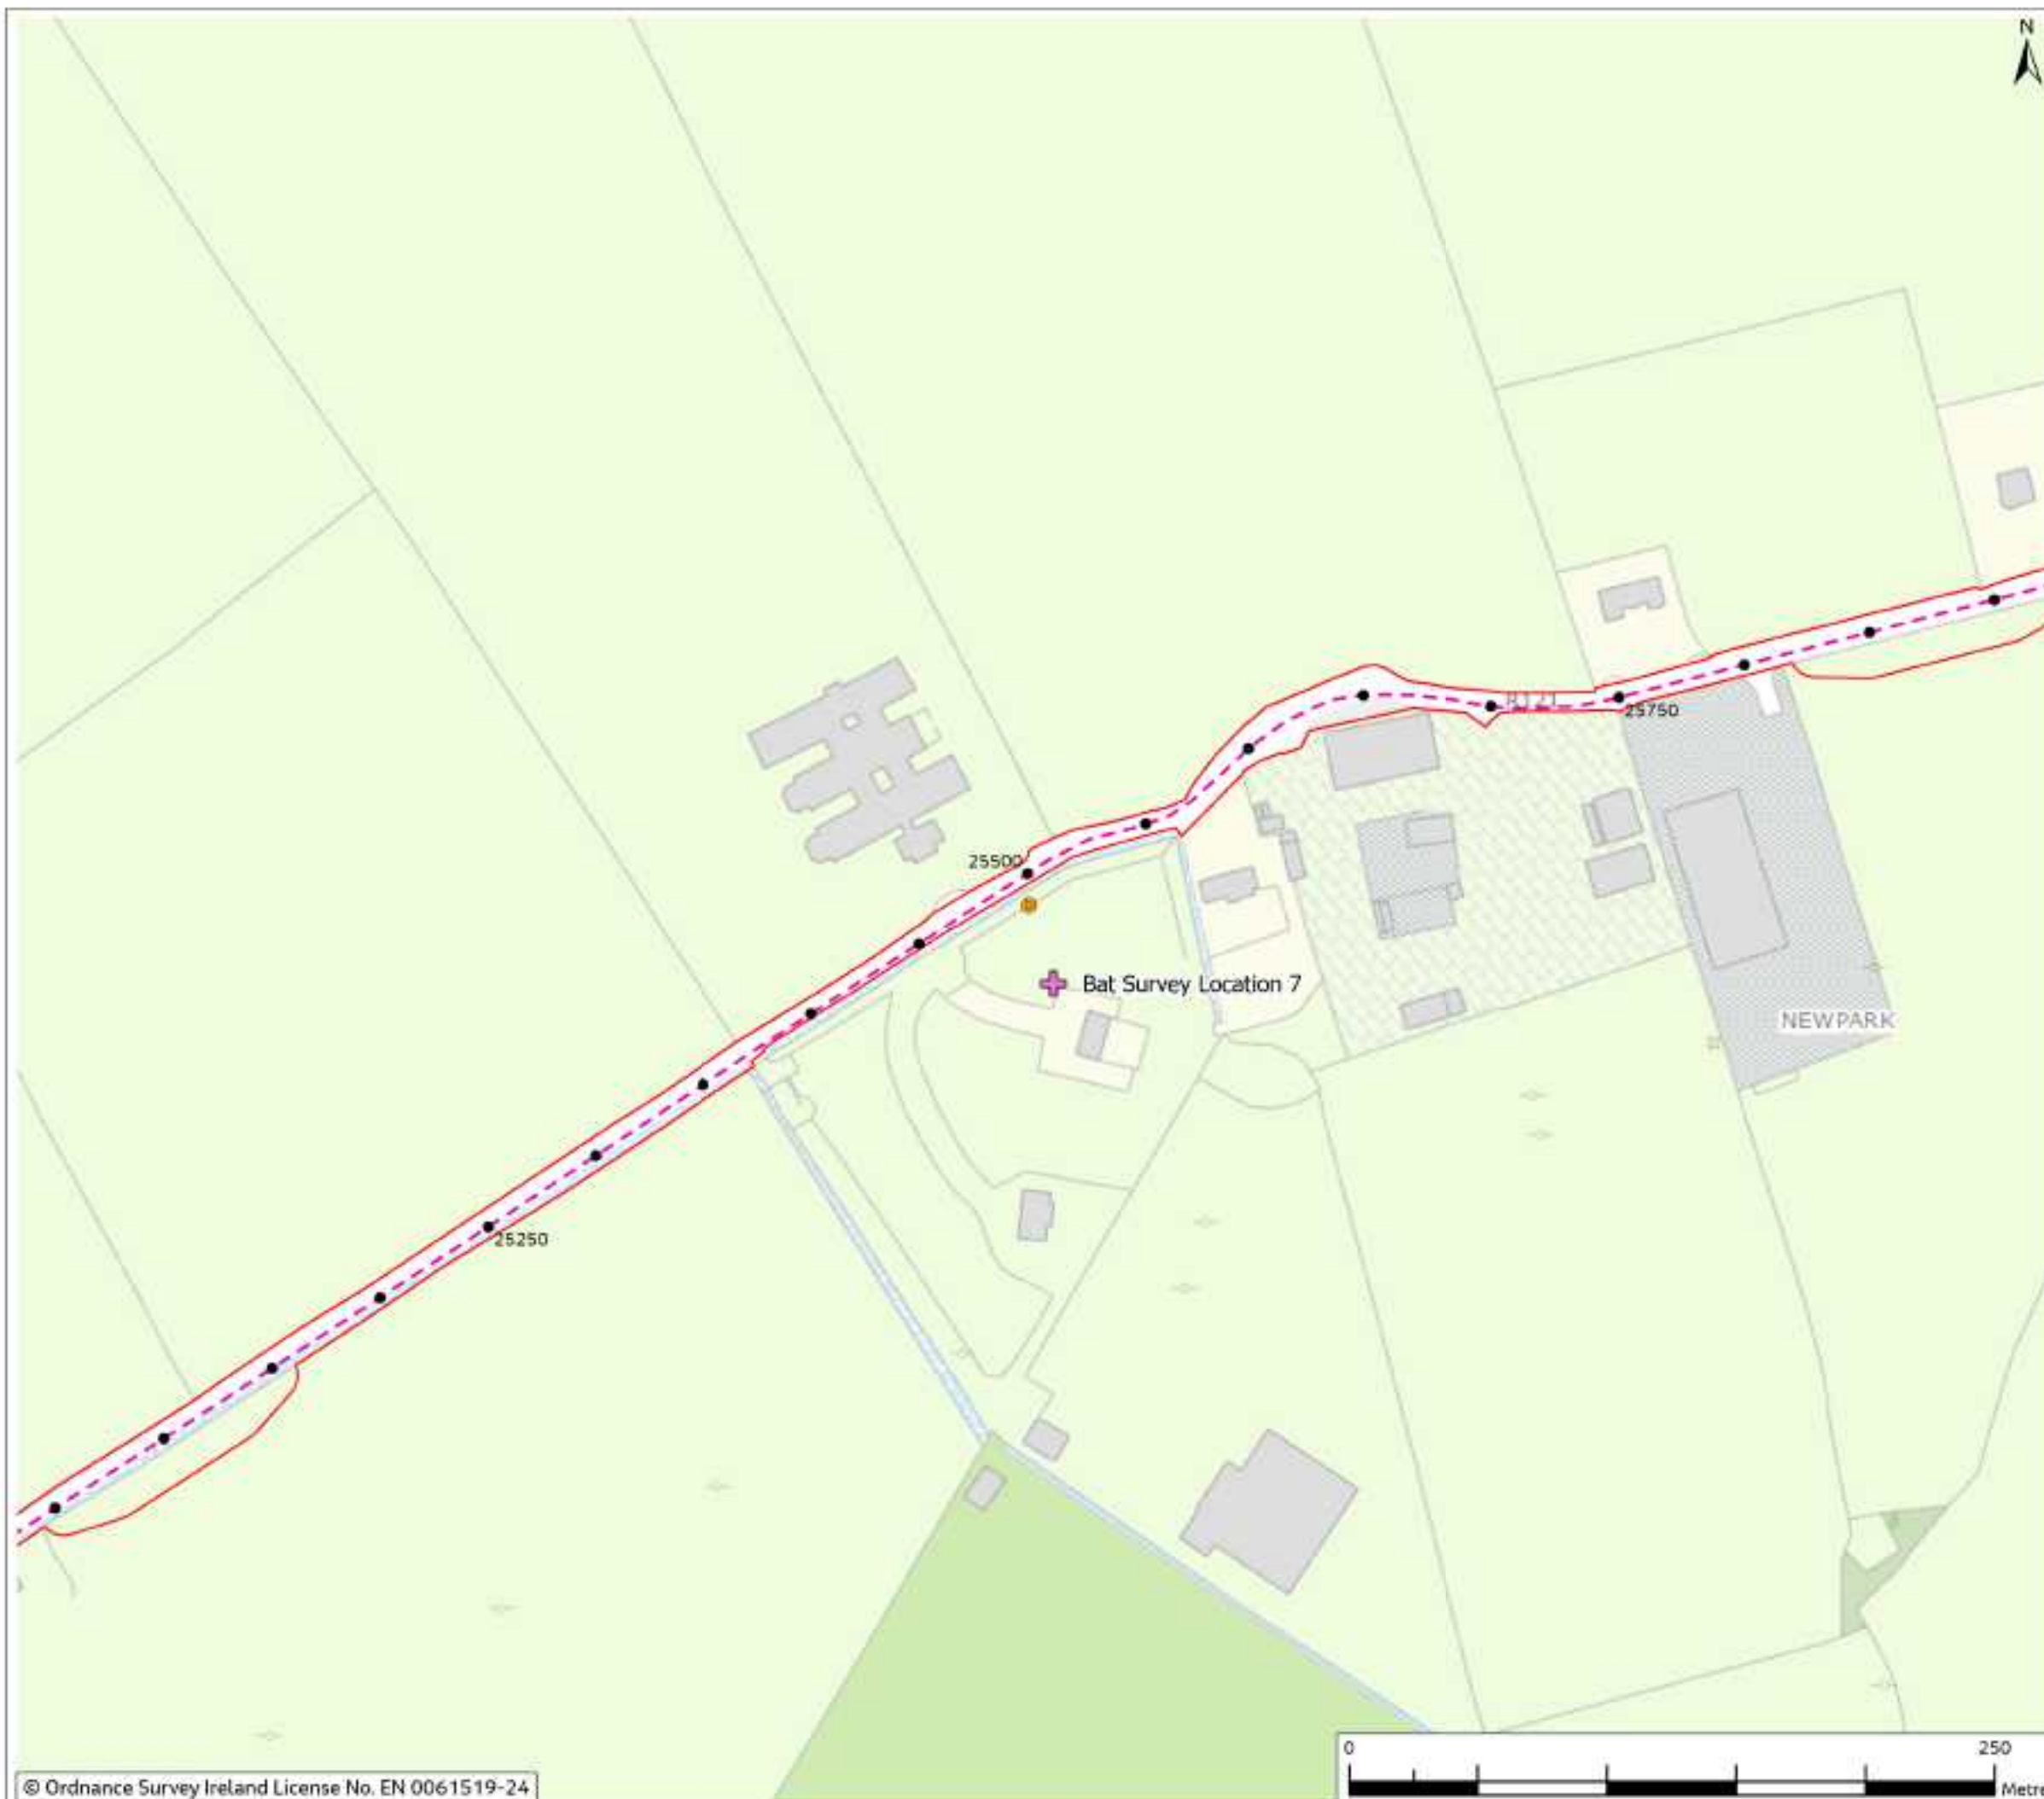

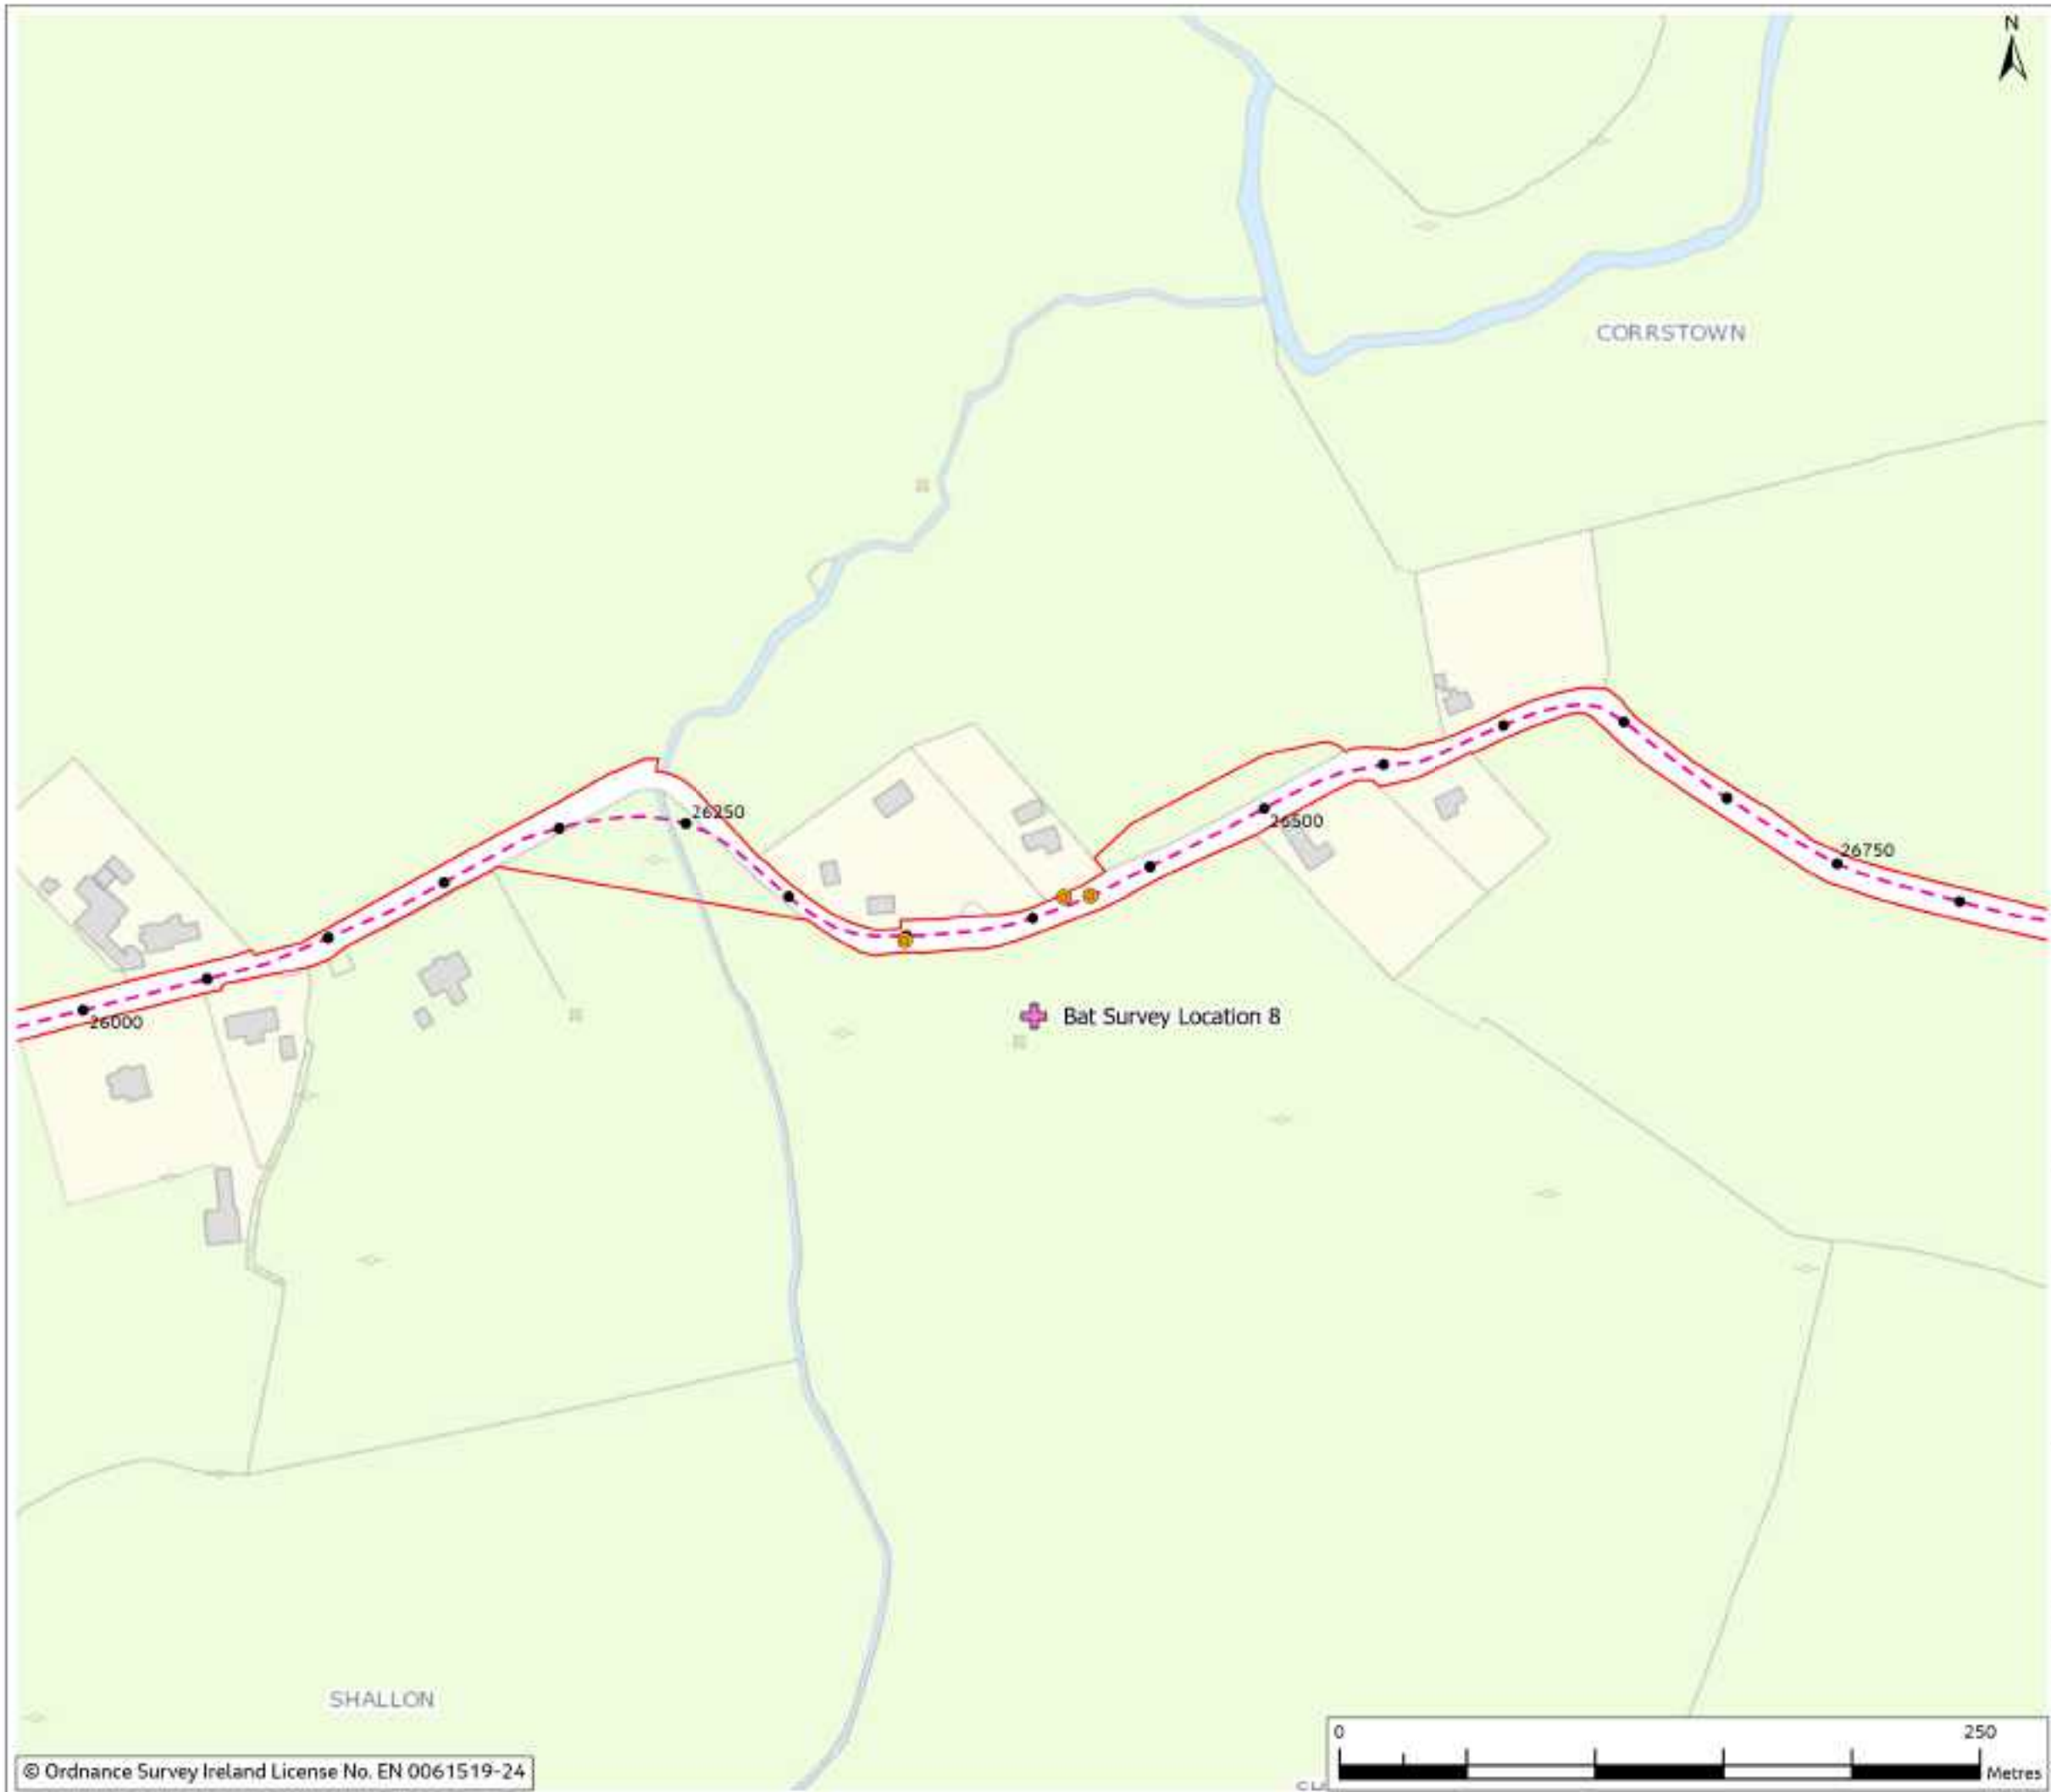


Figure 10.6

- Legend**
- Chainage
 - Planning Application Boundary (PAB)
 - - - Proposed Cable Route
 - ✚ Bat Survey Location
- Ground assessment of tree roosting potential**
- High Potential
 - Moderate Potential

Bat Survey Location Group 8
Bat species recorded flying outside trees but not emerging or re-entering during emergence / re-entry surveys

P.pip	P.pyg	N.lai	M.nat	P.aur
Yes	Yes	Yes	Yes	Yes



0	Mar 2024	Final	Rev	PS	RS	CS
Rev	Date	Purpose of revision	Drawn	Checked	Rev'd	App'd

Jacobs



East Meath - North Dublin Grid Upgrade

Figure 10.6 - Potential of Trees to Support Bat Roosts, and Dusk / Dawn Survey Locations with their Bat Activity (Sheet 8 of 8)

Drawing Status FINAL

Scale @ A3 1:2,500 **DO NOT SCALE**

OS Sheet No. 8321084AJ

Drawing No. 321084AJ-JAC-ZZ-XX-DR-G-0121

© Copyright 2024 Jacobs UK Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of, Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.